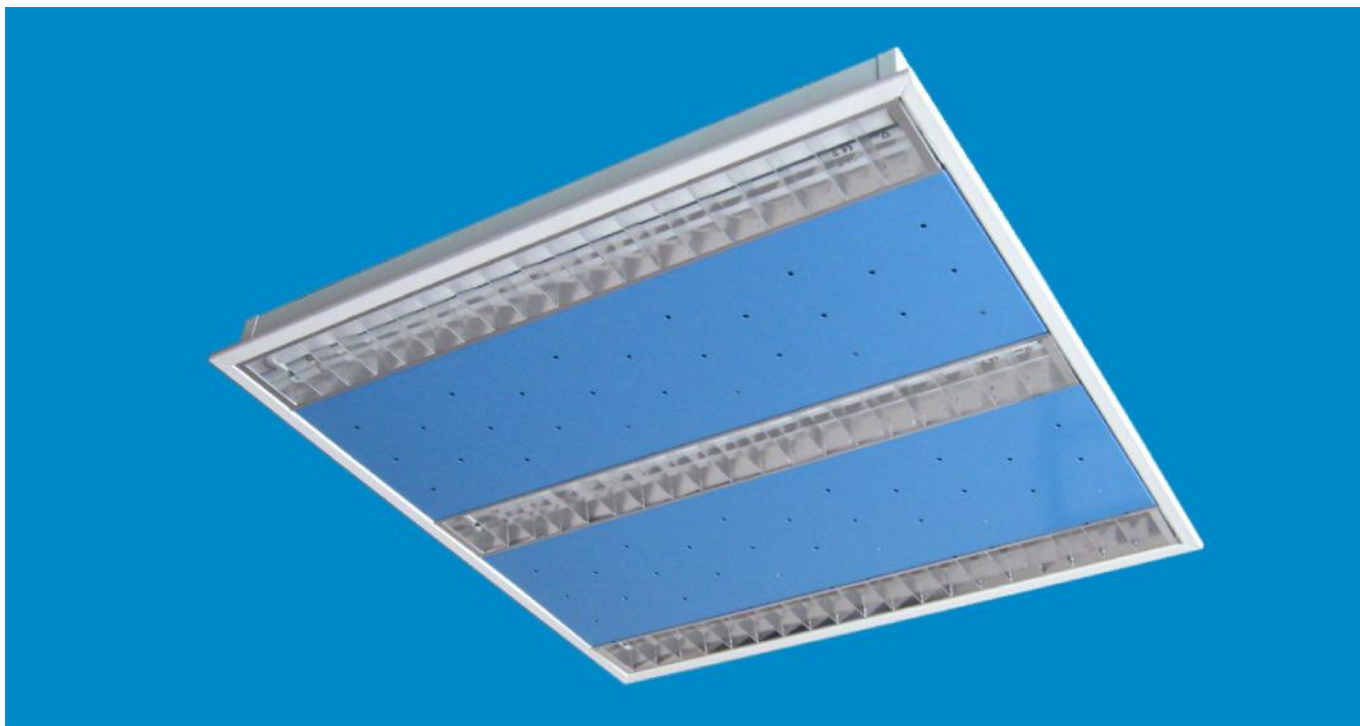


**OPRAWA WIETLÓWKOWA Z ODBŁY NIKIEM  
RASTROWYM  
FLUORESCENT LUMINAIRE WITH MIRROR  
LOUVRE****OF4371****PRZEZNACZENIE**

Oprawy przeznaczone s do o wietlenia pomieszcze . Mog by instalowane w suficie podwieszonym z widocznymi szynami teowymi.

**BUDOWA**

Oprawy przystosowane s do wietlówek prostych T5. Korpus oprawy wykonany jest z blachy stalowej i malowany biały farb proszkow . Paraboliczne odbły niki, indywidualne dla ka de j ze wietlówek, wykonane s z polerowanej blachy aluminiowej. Poprzeczne płytki rastra wykonane s z ta my aluminiowej profilowanej. Przy wymianie wietlówek raster pozostaje jednostronnie podwieszony do oprawy.

Oprawy wyposa one s w statecznik elektroniczny. Przewidziane s odmiany wyposa one w moduł bateryjny podtrzymuj cy wiecenie oprawy. W przypadku zaniku napi cia w sieci energetycznej jedna ze wietlówek zasilana jest z własnej baterii, zapewniaj c swiecenie przez min. 1h. Wydłu ony czas wiecenia - na yczenie. Na yczenie oprawy mog by dostosowane do współpracy z systemem centralnej baterii o wietlenia awaryjnego oraz wyposa one w rozdzielone obwody wietlówek (np. w dwa stateczniki w układzie 3+1).

**NORMY I PRZEPISY**

PN-IEC 598

**DESIGNATION**

The lighting fitting is purposed for illumination of offices, halls, etc. in buildings. Fittings are designed for mounting in suspended T-bar structure ceilings.

**CONSTRUCTION**

The fittings are adapted for standard T5 tubes. The housing is made of steel sheet painted with white powder. Parabolic mirror louvres (separately for each tube) are made of polished aluminium. Transverse plates are made of profiled aluminium tape. During the fluorescent tubes change operation the louvre is hung down on one side.

Fittings are equipped with electronic ballast.

There are versions with battery backup unit. The battery unit, in case of voltage decay, maintains illumination (one fluorescent tube is supplied from a self - contained battery).


It gives lighting during 1 hour. Longer duration of emergency lighting - on request.

On request, fittings can be adapted to central battery system of emergency lighting and equipped with separate circuits of tubes (e.g. two electronic ballasts - system 3+1).


**STANDARDS AND RULES**

IEC-598

Rysunki gabarytowe / Dimensioned drawings

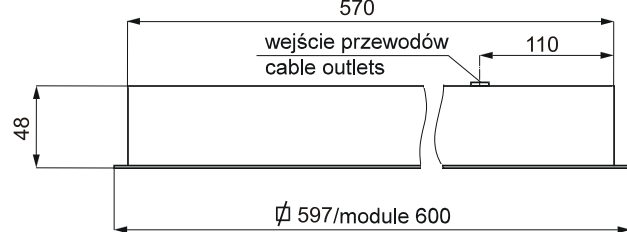


rys.1 / drwg 1

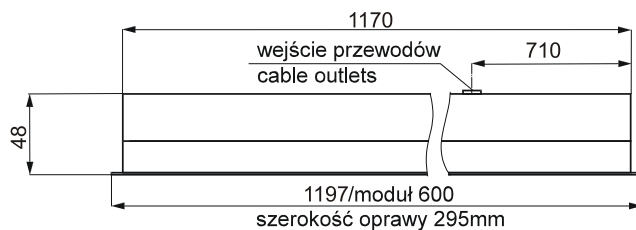

rys.2 / drwg 2

Wykresy rozsyłu światła / Light distribution diagrams  
cd/klm

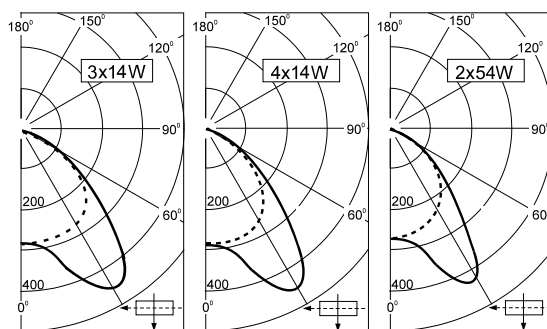

⊕ —○— ☹ cos φ = 0,95

Typ oprawy	Moc źródła światła	Napięcie zasilające	Sprawność świetlna	Kształt odbłyśnika	Stopień ochrony	Moduł sufitu	Oświetlenie awaryjne	Nr rys. gabaryt.	Masa /kg/					
OF4371-01	2x14W	220÷230V 50/60Hz	0,75	półparaboliczny semi-parabolic	IP20	600mm	-	1	3,0					
OF4371-02	3x14W							2	2,8					
OF4371-03	4x14W							1	4,0					
OF4371-04	2x54W							2	3,8					
OF4371-05	2x14W		+				0,72	półparaboliczny semi-parabolic	IP20	600mm	-	3,0		
OF4371-06	3x14W												1	4,0
OF4371-07	4x14W												2	3,8
OF4371-08	2x54W												1	4,0
Fitting type	Light source power	Supply voltage	Light output ratio	Louvre form	Protection grade	Ceiling module	Emergency lighting				Drwg No.	Mass /kg/		

Dostawa bez ról światła / Lamps not included